


PLAN VIEW  
Not to Scale

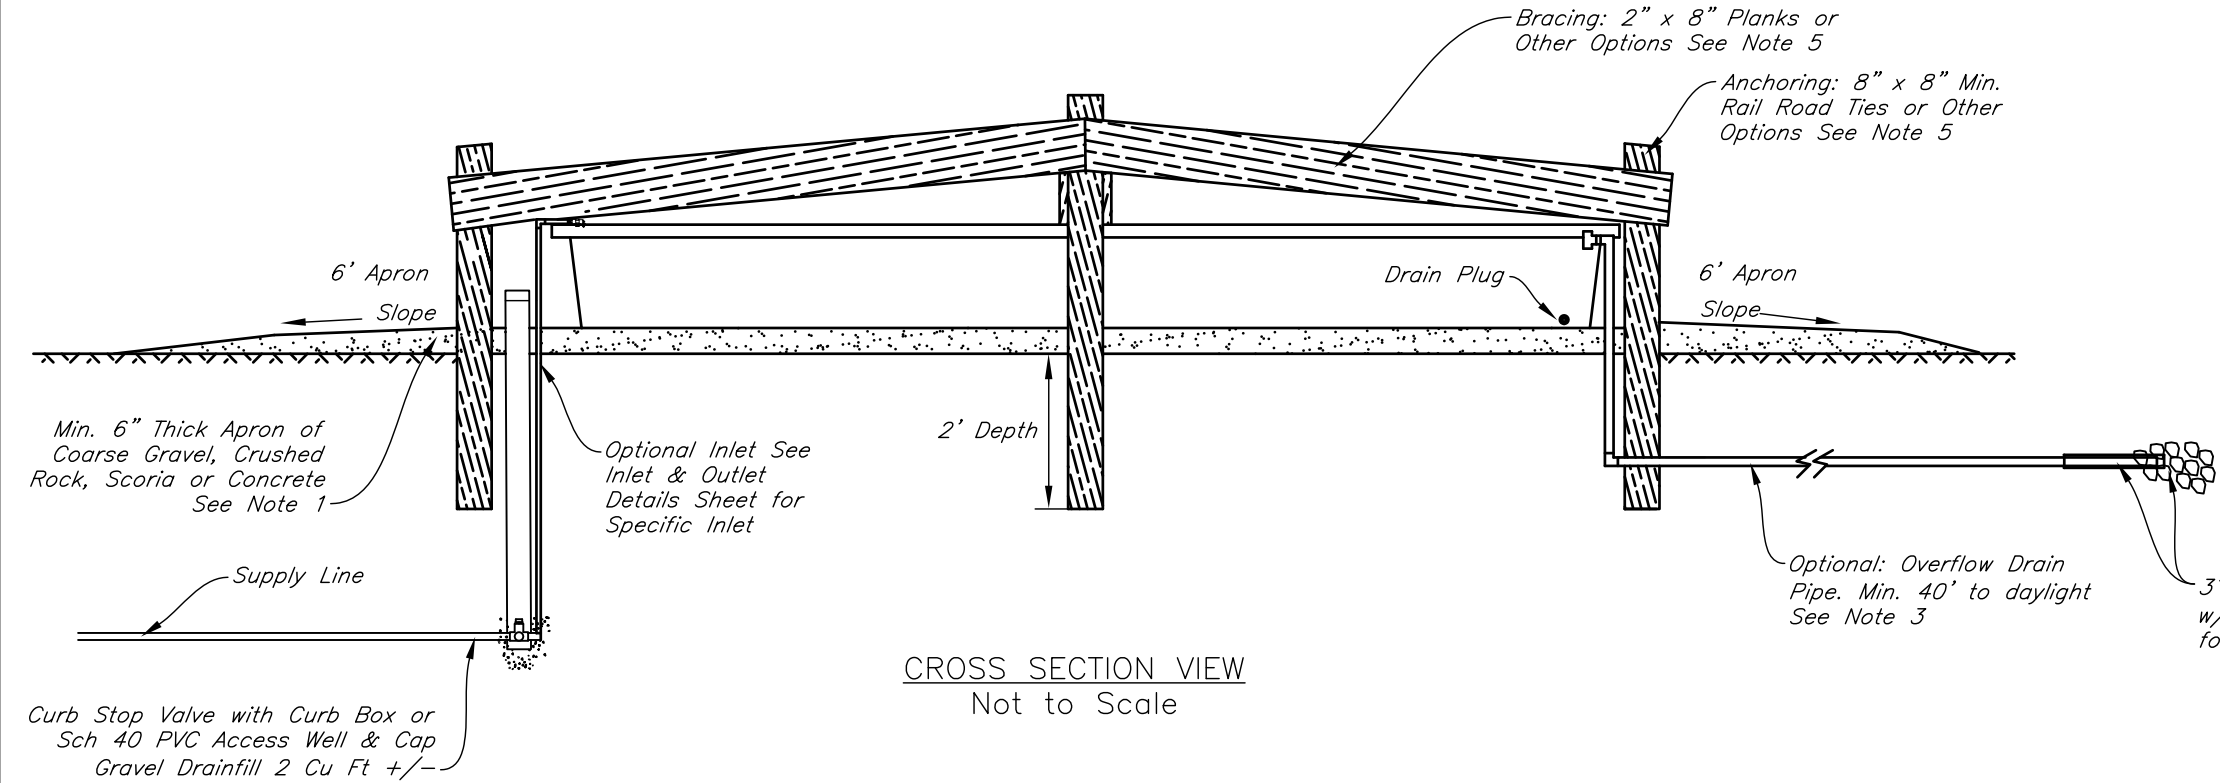

CROSS SECTION VIEW  
Not to Scale

Rectangular Tank Installation		
Size	Capacity Gal	Gravel CuYd
8' x 12'	1300	8.9
8' x 16'	1700	10.4
7' x 20'	2000	11.3
8' x 20'	2200	11.9
Tank Capacity will vary by manufacturer		

CONSTRUCTION NOTES

- In all cases the tank and apron area shall be stripped of all organics and the tank placed on a stable, well compacted foundation. Install min 6" of compacted fine gravel or sand on sites with clay soils with high shrink/swell potential. 2" Max. Dia. gravel. Optional on lighter or gravelly soils with little or no potential for shrink/swell. And in accordance with manufacturer's recommendations.
- All fiberglass watering facilities shall have a nominal min. thickness of 3/8" and shall be manufactured in accordance with ASTM-D4097 or ASTM-D3299. Exposed fiberglass watering facilities shall contain ultraviolet (UV) inhibitors or have a durable coating to protect the tank from deterioration due to sunlight
- An overflow and drain pipe Sch 40 PVC with a minimum 2" diameter or at least 1/2" Dia. larger than the supply line, must be installed if the water level in the tank is not controlled with a float. The pipe shall be graded to allow drainage and a min. of 40' from the tank. Protect the pipe at outlet end by backfilling over pipe with field stone.
- Hydrant and float or overflow must be protected.
- Anchoring will be adjacent to the watering facility and embedded in the ground. Anchors can be 1/2" rod, standard T or U section steel post (1.33lb/ft), metal pipe (2 7/8" OD Min.) with cap, treated wood post (5" Top Dia. Min.), or as specified by the manufacturer. Bracing can be 2"x8" planks, metal pipe (2" OD Min.) or guard rail. Other materials and configurations for tank anchoring and bracing will be considered with prior NRCS approval.
- A wildlife escape ramp is required every 30' of the perimeter of the tank with exception for tanks with less than 10 square feet of contiguous open water area. Escape ramps molded into the tank edges by the manufacturer during fabrication are acceptable. See wildlife escape ramp detail sheet.
- PVC pipe shall be made of ultraviolet (UV) resistant materials or shall have a durable coating of UV resistant paint to protect it from deterioration due to sunlight. PVC pipe used for access to appurtenances is exempt from this requirement.

Date \_\_\_\_\_  
 Designed \_\_\_\_\_  
 Drawn Cassie Ahmed 03-22-2024  
 Checked \_\_\_\_\_  
 Approved \_\_\_\_\_

RECTANGULAR STOCKWATER TANK  
 OWNER: \_\_\_\_\_  
 COUNTY: \_\_\_\_\_



File Name  
ND-DWG-103  
 Date  
03-22-2024  
 Sheet of \_\_\_\_\_