

CONSTRUCTION NOTES


1. A minimum 4 gallon surge tank is required.
2. This drawing represents a typical installation. Other types of installations may also be used with prior approval from the NRCS Representative.

AS BUILT

VFD Controller Manufacturer _____

VFD Controller Model Number _____

VFD Controller Setting _____PSI _____GPM

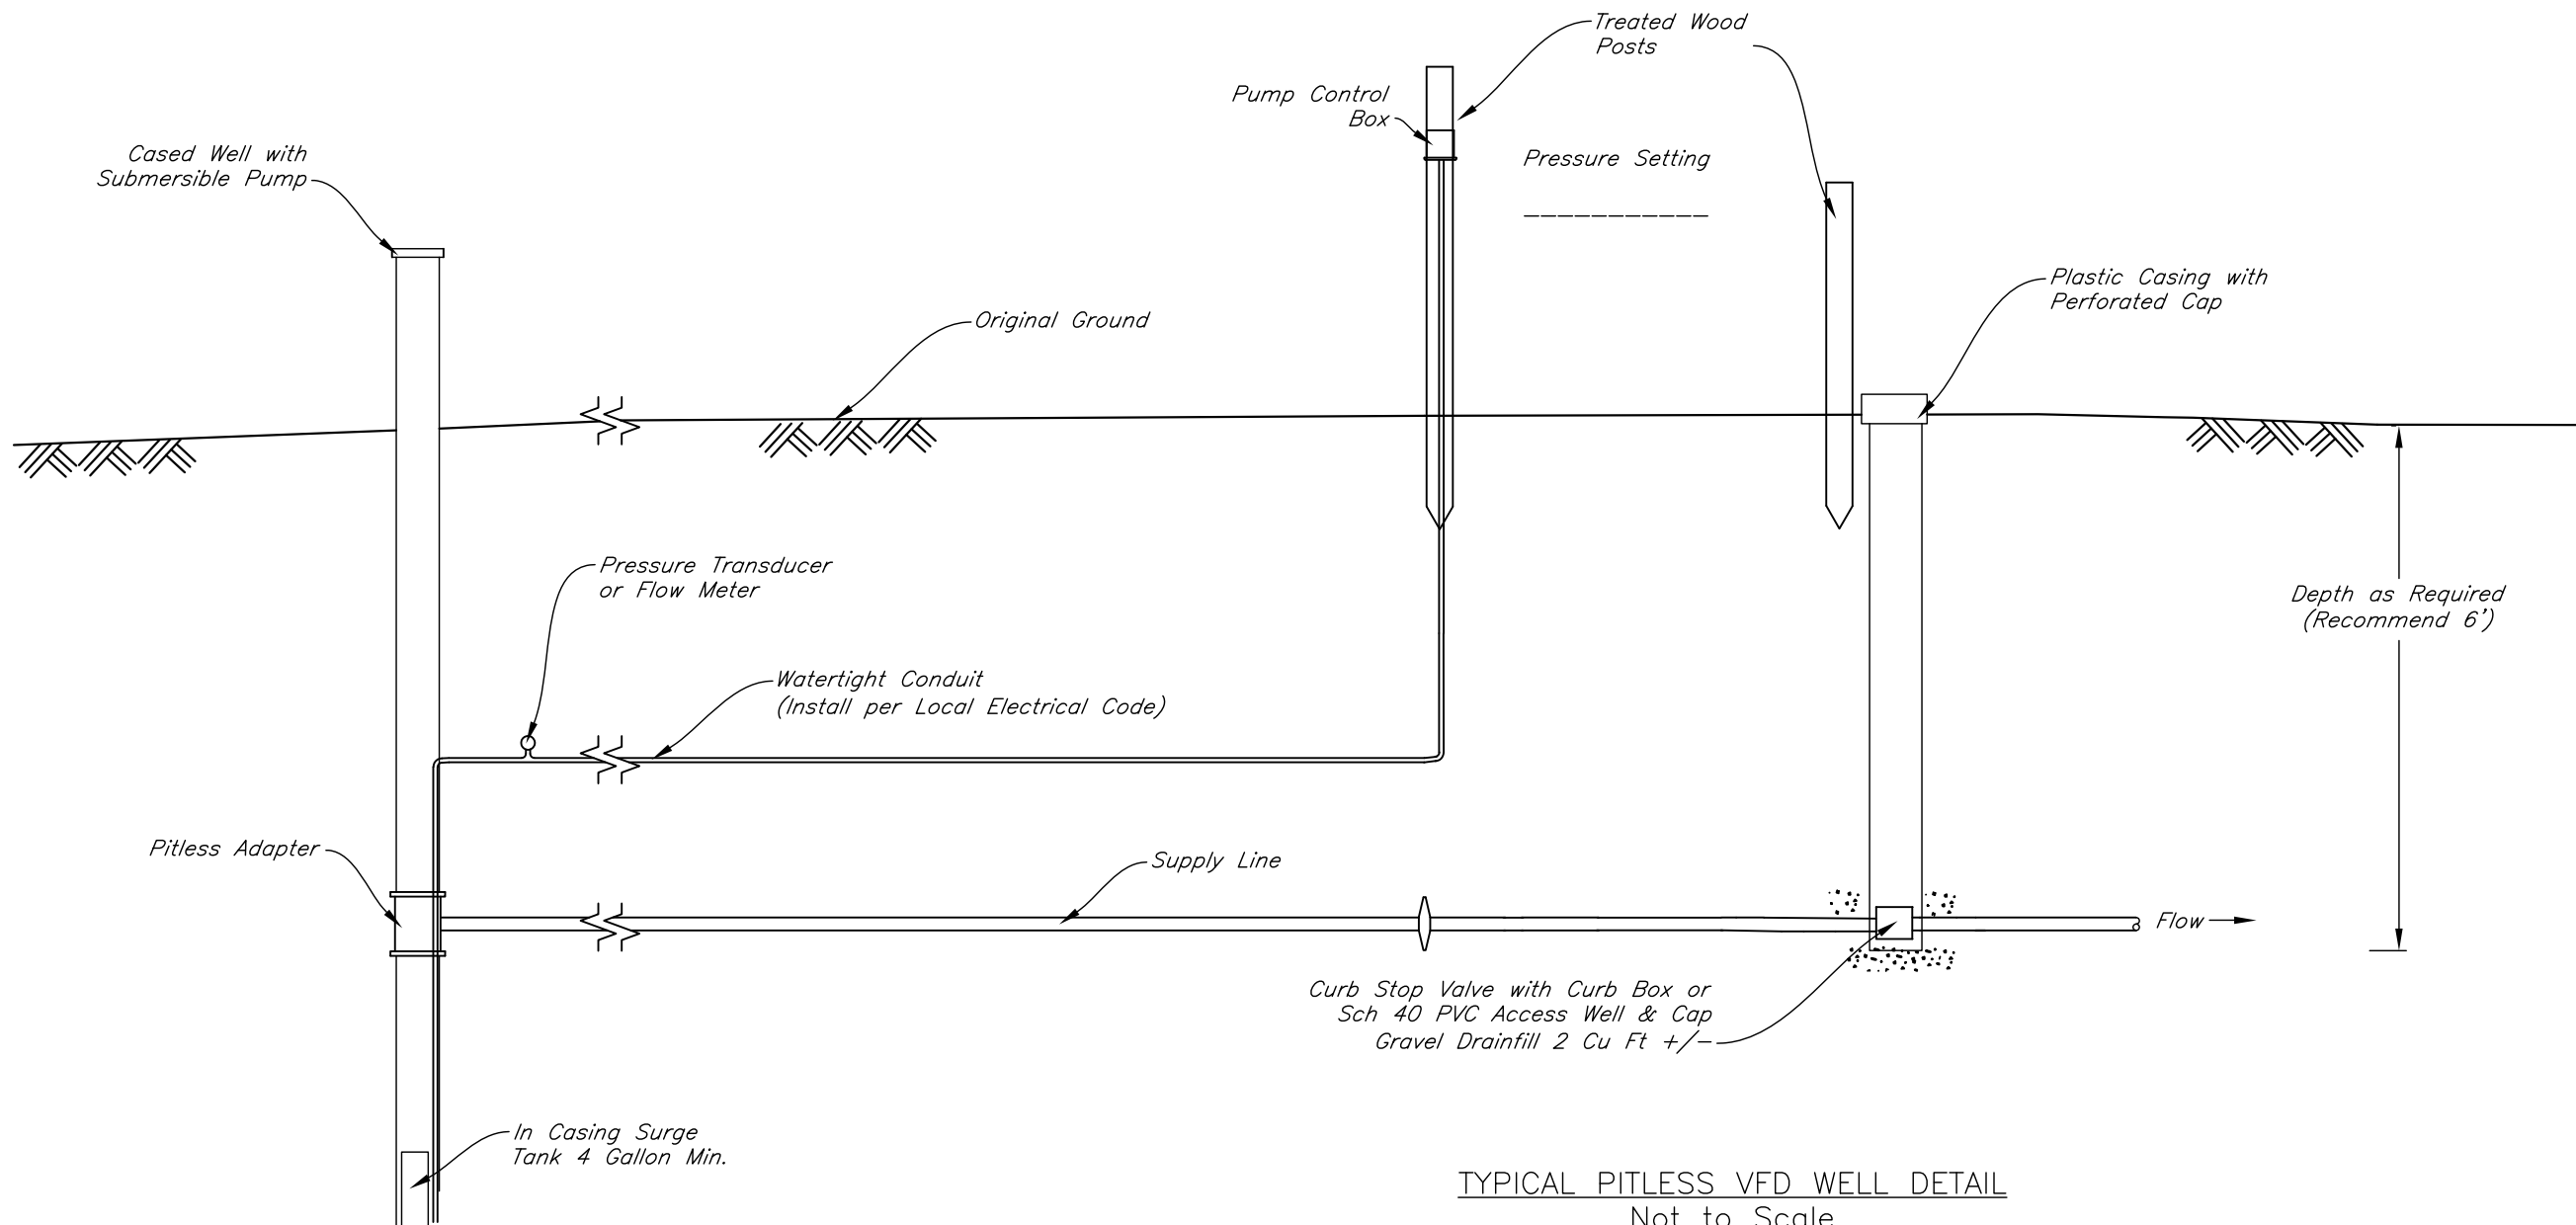

TYPICAL PITLESS VFD WELL DETAIL
Not to Scale

Date	_____
Designed	_____
Drawn	Cassie Ahmed 03-22-2024
Checked	_____
Approved	_____

VARIABLE SPEED ABOVE GROUND DETAILS

OWNER: _____

COUNTY: _____

United States
Department of
Agriculture



Natural Resources
Conservation Service

File Name
ND-DWG-140

Date
03-22-2024

Sheet of _____